

Este informe contiene informacion muy importante sobre su agua potable.
Traduzcalo o hable con alguien que lo entienda bien.

CANCELLATION OF BOIL WATER NOTICE

October 20, 2025

Lake of the Woods Mutual Water Company (1510023)

Impacted Customers in South Pressure Zone

On October 18, 2025, the customers of Lake of the Woods Mutual Water Company (LOW MWC) in the **South Pressure Zone of Lake of the Woods from the corner of Lakeview Drive and Lakewood Drive by the Catholic Church, up Paige and part of Lakeview Drive at the top part by Lakeview Terrace, and some of Crable** were notified of the need to boil/disinfect all tap water used for drinking and cooking purposes from October 18, 2025 until further notice. The precautionary Boil Water Notice was issued due to the replacement of the waterline on Paige Rd due to multiple leaks in recent months that caused flooding on customers property. LOW MWC temporarily shut down Wells 04 & 06 to repair the leak. After completing the new tie in & restoring the pressure in the distribution system on **October 18, 2025**, two (2) bacteriological samples were collected from the distribution system on **October 18, 2025**, and both samples tested absent for total coliform bacteria.

The LOW MWC in conjunction with the State Water Resources Control Board, Division of Drinking Water has determined that, through comprehensive testing of the water, your water is now considered safe to drink. **It is no longer necessary to boil your tap water or for you to consume bottled water.**

For more information call:


Pamela Jarecki or Brenda Fessia at Lake of the Woods Mutual Water Company at (661) 917-7317 or the LOW Mutual Water Company's office number at 661-245-1448.

State Water Resources Control Board, Division of Drinking Water at 661-335-7315.

This notice is being sent to you by the Lake of the Woods Mutual Water Company.

State Water System ID#: CA1510023 Date distributed: 10-20-2025

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

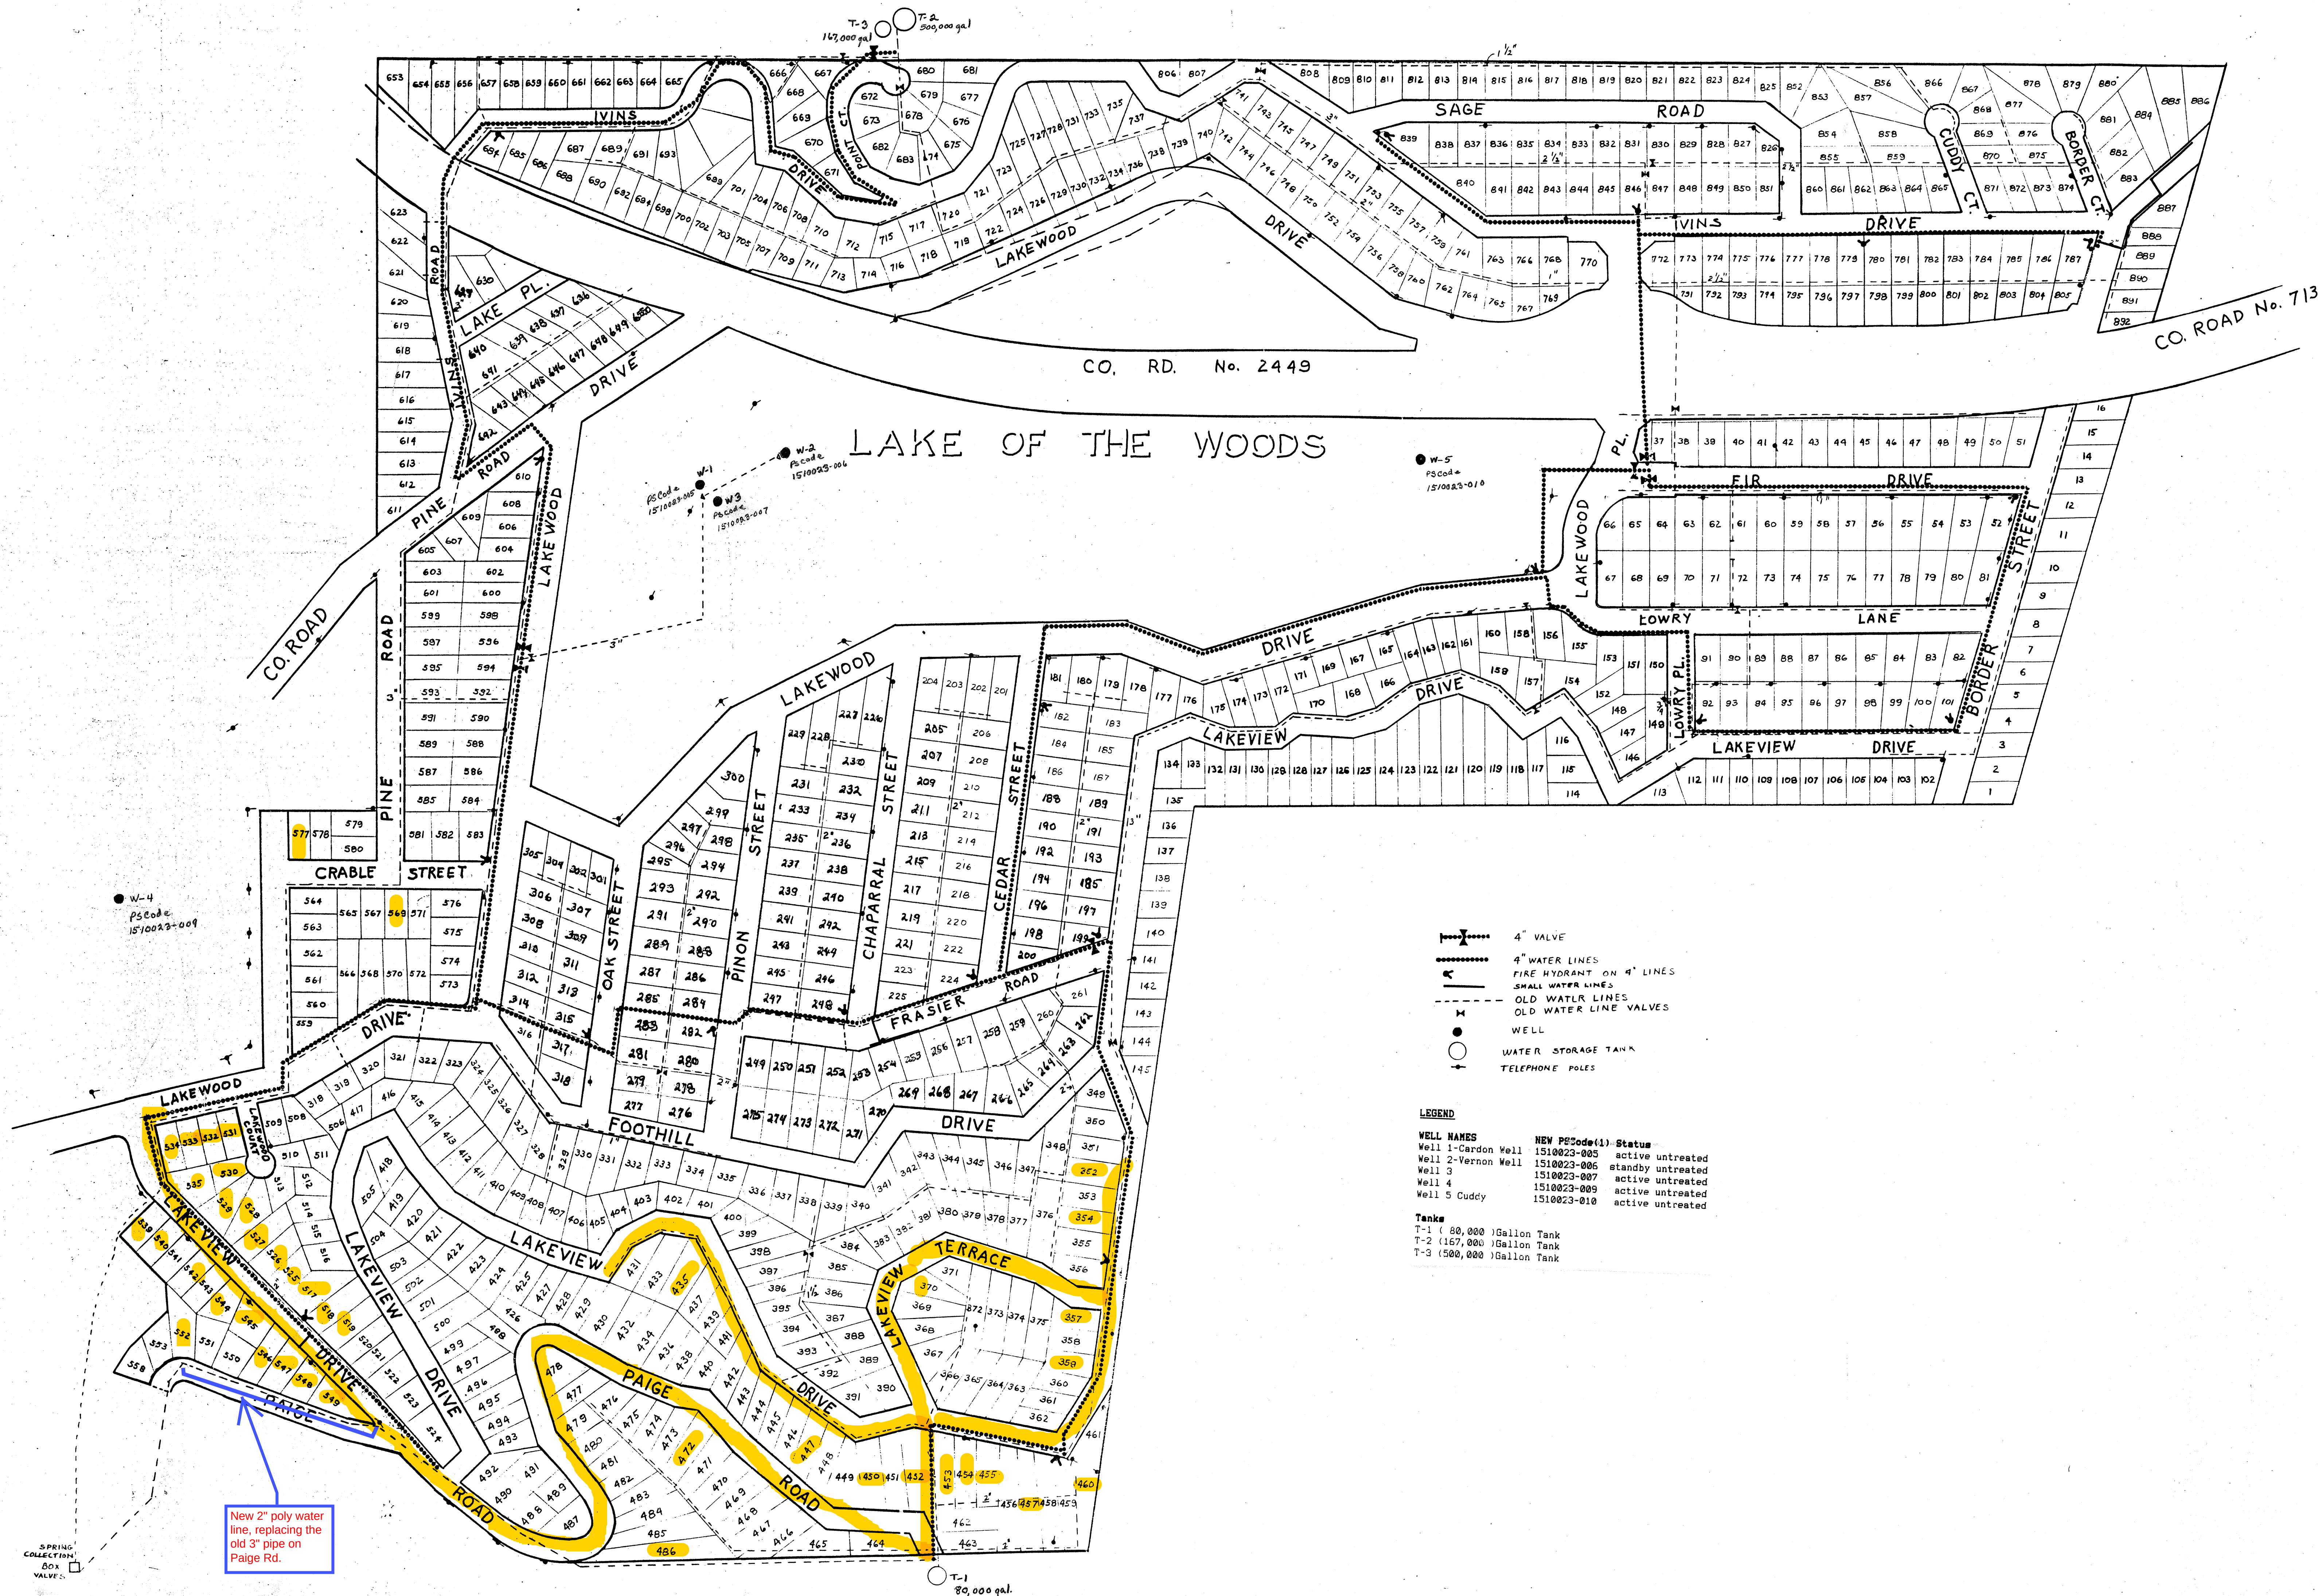

- 4" VALVE
- 4" WATER LINES
- FIRE HYDRANT ON 4" LINES
- SMALL WATER LINES
- OLD WATER LINES
- OLD WATER LINE VALVES
- WELL
- WATER STORAGE TANK
- TELEPHONE POLES

LEGEND		
WELL NAMES	NEW PSCode(1)	Status
Well 1-Cardon Well	1510023-005	active untreated
Well 2-Vernon Well	1510023-006	standby untreated
Well 3	1510023-007	active untreated
Well 4	1510023-009	active untreated
Well 5 Cuddy	1510023-010	active untreated

Tanks
T-1 (80,000)Gallon Tank
T-2 (167,000)Gallon Tank
T-3 (500,000)Gallon Tank

New 2" poly water line, replacing the old 3" pipe on Paige Rd.